



Face

Danish Institute of Fire and Security Technology

File no. PG 10842


*Jens Billestrup*

|                  |  |   |
|------------------|--|---|
| Date: 2001.05.17 | A 60 bulkhead insulated with 65 mm Rockwool Marine Firebatts 130 and 30 mm Rockwool Marine Wired Mat 105 at stiffeners | <br>Rockwool International A/S |
| Drawing: KMP     |  |   |
| Scale 1:20       |  |   |



30 mm Rockwool Marine Wired Mat 105


65 mm Rockwool Marine Firebatts 130

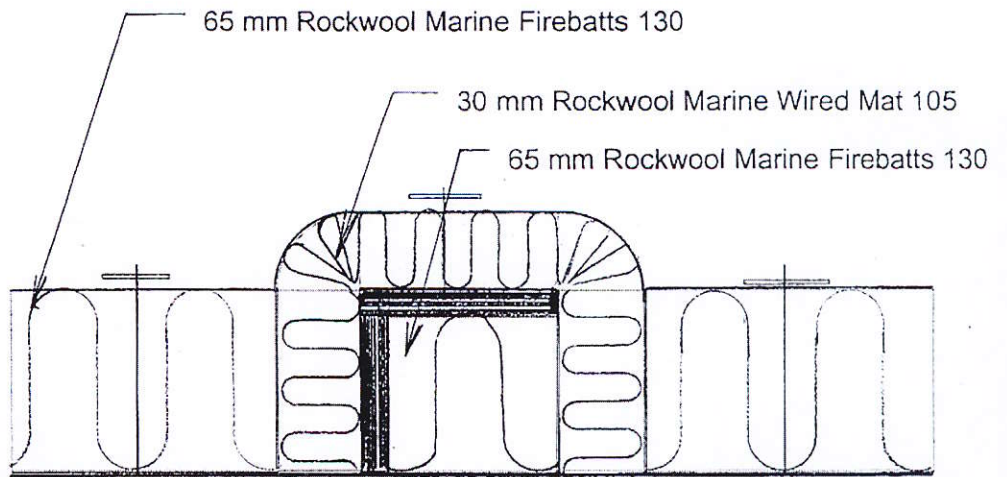

65 mm Rockwool Marine Firebatts 130

30 mm Rockwool Marine Wired Mat 105

65 mm Rockwool Marine Firebatts 130




Date: 2001.05.17

Drawing: KMP

Scale: not to scale

A 60 bulkhead insulated with 65 mm Rockwool Marine Firebatts 130 and 30 mm Rockwool Marine Wired Mat 105 at stiffeners

Rockwool International A/S

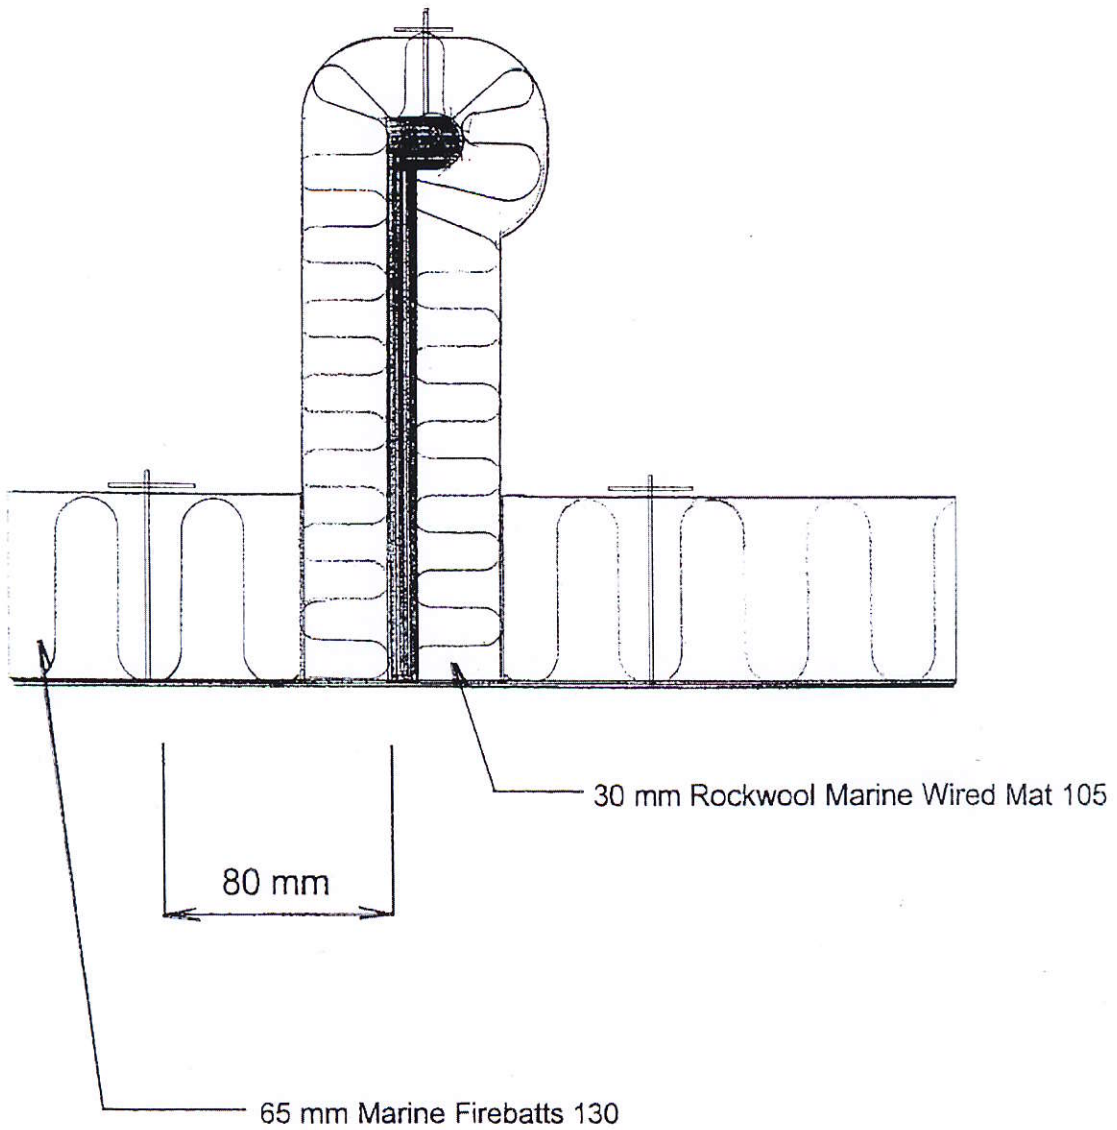

Date: 2001.05.16

Drawing: KMP

Scale: not to scale

A 60 bulkhead insulated with 65 mm Rockwool Marine Firebatts 130 and 30 mm Rockwool Marine Wired Mat 105 at stiffners.  
Alternative installation

Rockwool International A/S




30 mm Rockwool Marine Wired Mat 105

65 mm Rockwool Marine Firebatts 130

Danish Institute of Fire and Security Technology  
File no. *PG 10842*

*Jens Nielsen*

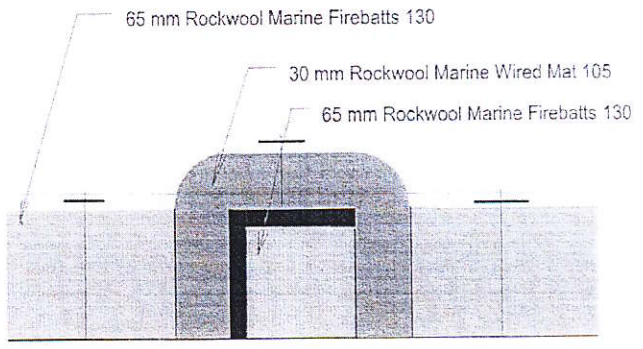

80 mm

Date: 2001.05.17  
Drawing: KMP  
Scale: not to scale

A 60 bulkhead insulated with 65 mm Rockwool Marine Firebatts 130 and 30 mm Rockwool Marine Wired Mat 105 at stiffeners

**ROCKWOOL**  
Rockwool International A/S